


H-Structure Construction Specifications

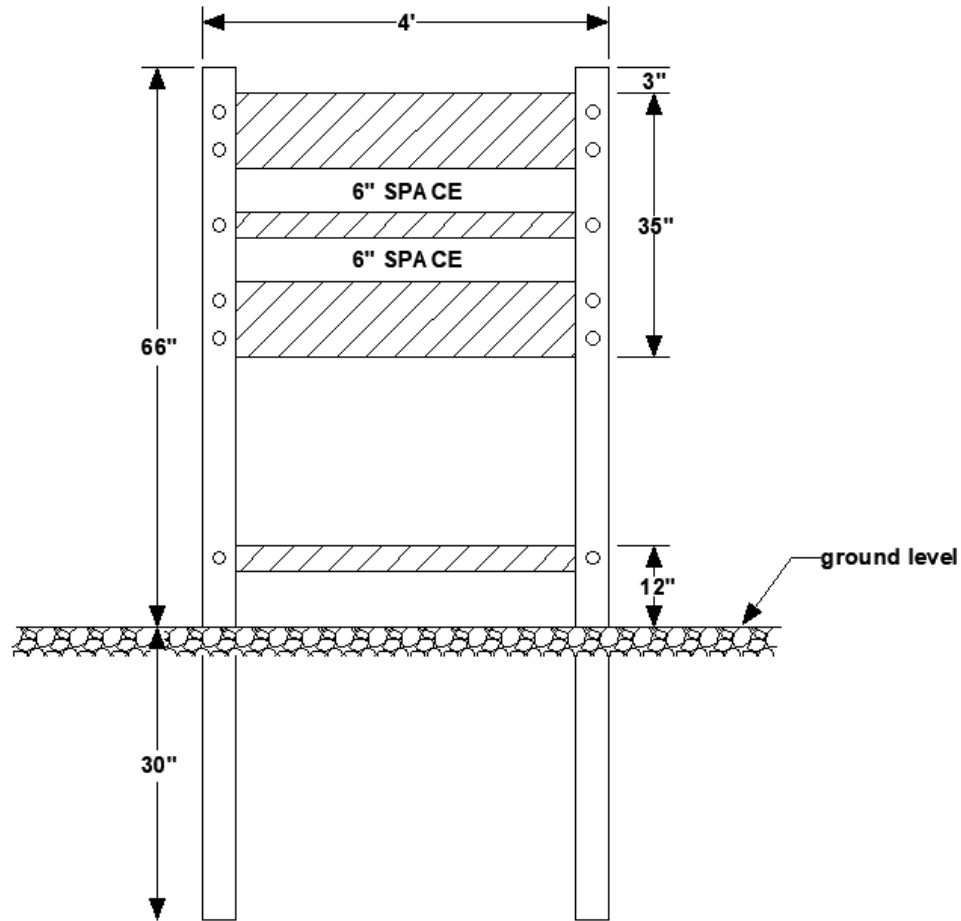

Material required (minimum timber size and recommended bolts).

- 2-4"x4"x8' treated posts
- 2-2"x4"x4' treated cross members
- 2-2"x10"x4' treated cross members
- 12-3/8"x6" carriage bolt w/ washers and nuts

Responsibilities

- Wood structure by member or consumer's electrician
- Meter bases installed by consumer or consumer's electrician
- Trench to LCP pole by consumer if greater than 320A—minimum of 24" deep
- Load side conductors and all conduits supplied by consumer.
- Source side conductors supplied by Lake Country Power if 320A or less.